


CA8500 – 8 Reader Access Control Board

DPS-15 Power Supply
 Dual linear DC outputs:
 - ACU output 12 VDC @ 1.2 Amperes
 - AUX/RDR output 12 VDC @ 1.2 Amperes
 The total current draw on each output should not exceed 1 Amp with 200 mA in reserve for accommodating peak current operating demands.

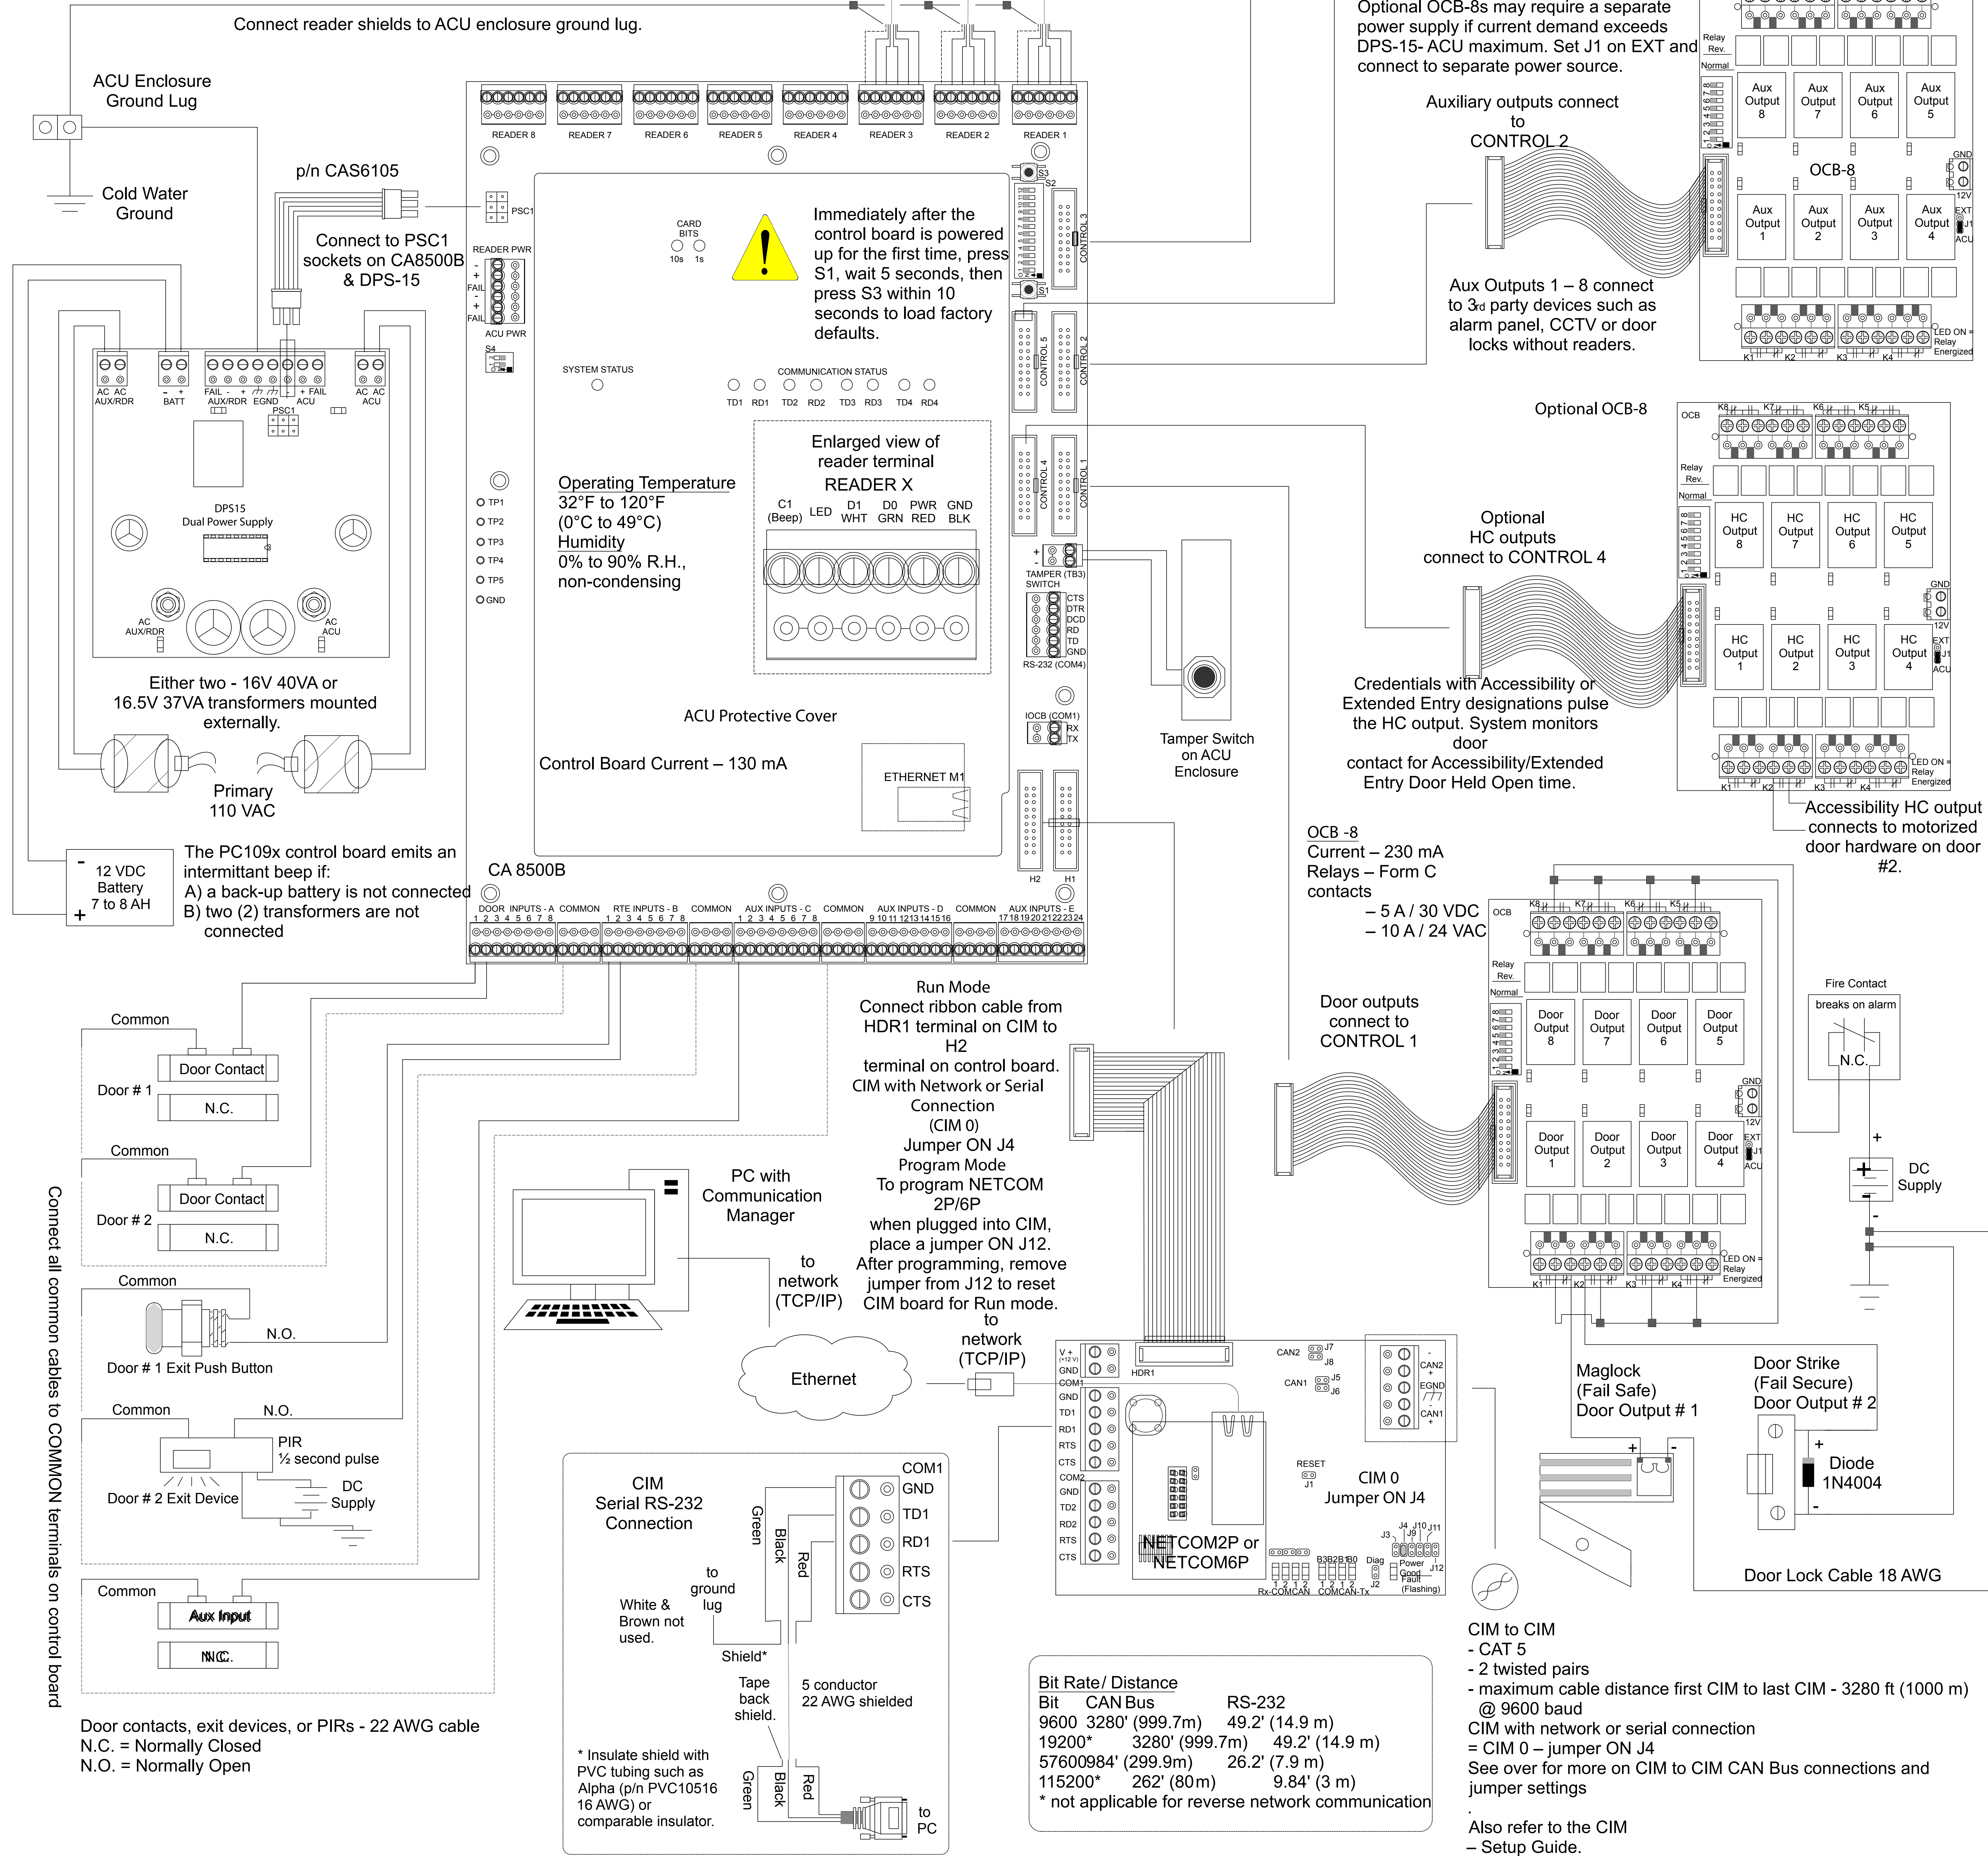

CA8500 Control Board – Serial # _____ (Communication address) / NETCOM Device – IP Address _____ Subnet Mask _____

Name	Reader # / Direction	Name	AI/SI #
Door # 1	_____	AI/SI # 1	_____
Door # 2	_____	AI/SI # 2	_____
Door # 3	_____	AI/SI # 3	_____
Door # 4	_____	AI/SI # 4	_____
Door # 5	_____	AI/SI # 5	_____
Door # 6	_____	AI/SI # 6	_____
Door # 7	_____	AI/SI # 7	_____
Door # 8	_____	AI/SI # 8	_____
		AI/SI # 9	_____
		AI/SI # 10	_____
		AI/SI # 11	_____
		AI/SI # 12	_____
		AI/SI # 13	_____
		AI/SI # 14	_____
		AI/SI # 15	_____
		AI/SI # 16	_____